


General information

Cavity

Type series: ER

Dimensions and sectional view

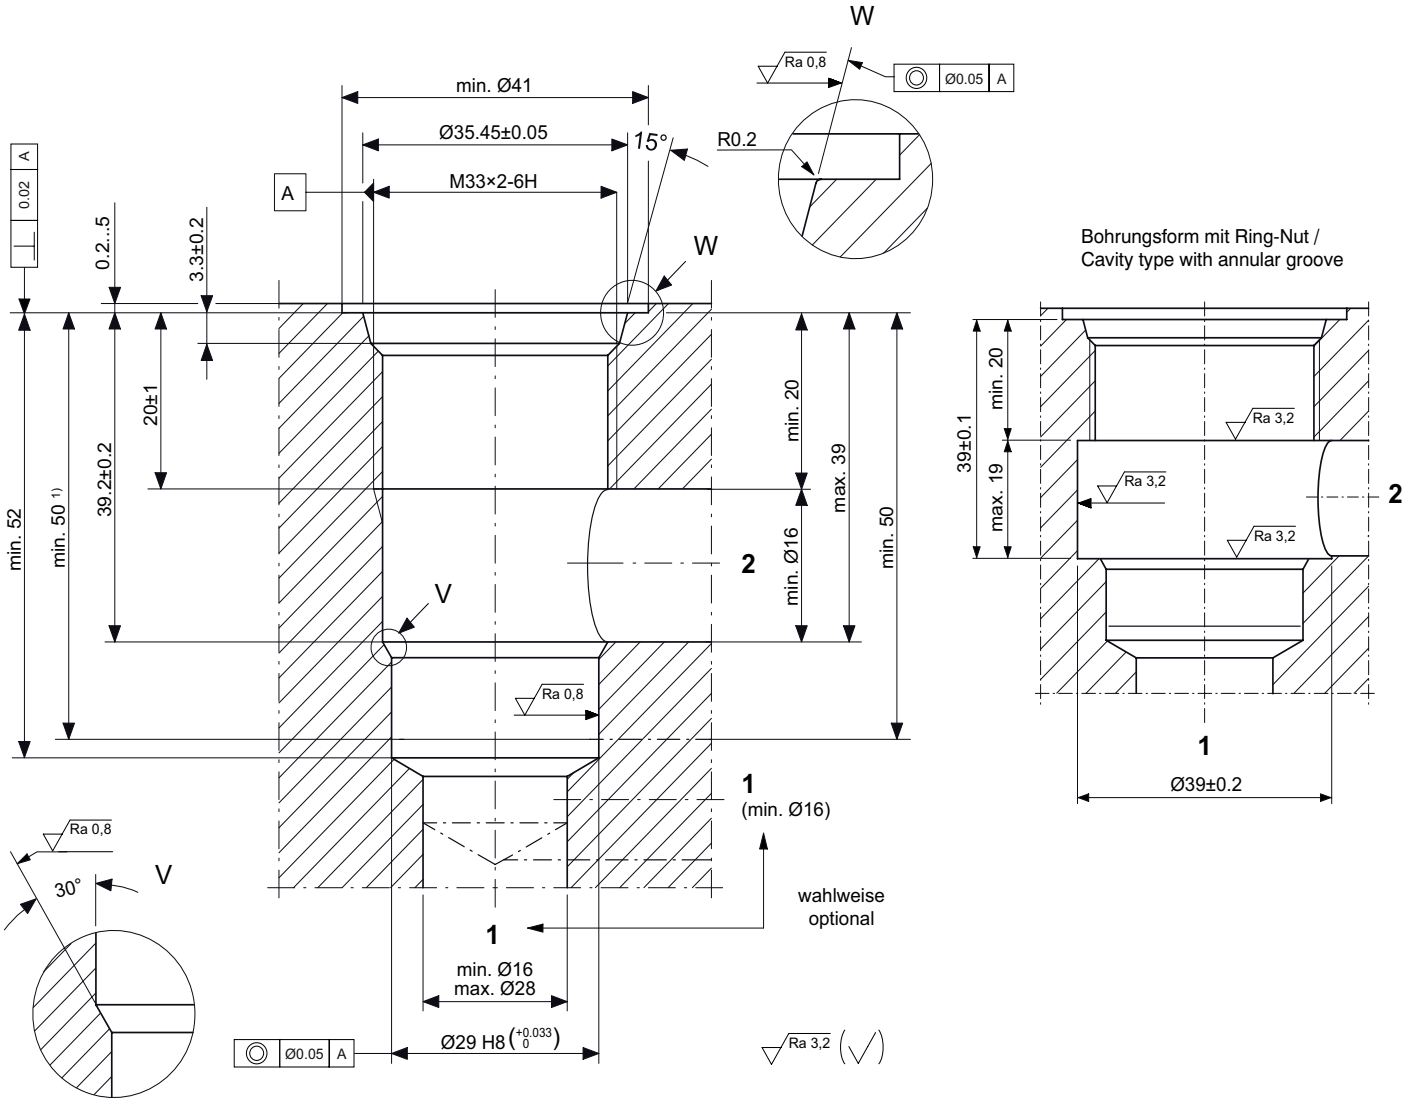

i HINWEIS!
NOTE!
1) Passungstiefe
Minimum depth of specified diametral tolerance

Beispiel für die Masseinheit:
Example for the dimensional units:
0.79 = 0.79 mm millimeter

Installation information

**ATTENTION!**

You must maintain the specified positional and diametral tolerances. To ensure trouble-free operation of the screw-in cartridges, we strongly recommend that pilot drilling, boring, reaming and cavity thread-cutting are always performed in one setup.

**ATTENTION!**

For improved Δp values with directional and logic valves, use the cavity with an annular groove in the 2 stage.

**NOTE!**

The cavity type ER complies with the standard according to ISO 7789: 33-01-0-07.

**NOTE!**

We offer form tool sets for sale or hire. For further information, see data sheet 400-P-040011.